



# ROLLESTONE INFANT & JUNIOR SCHOOL



# Rolleston Infant / Junior & Teachers Centre - Gas

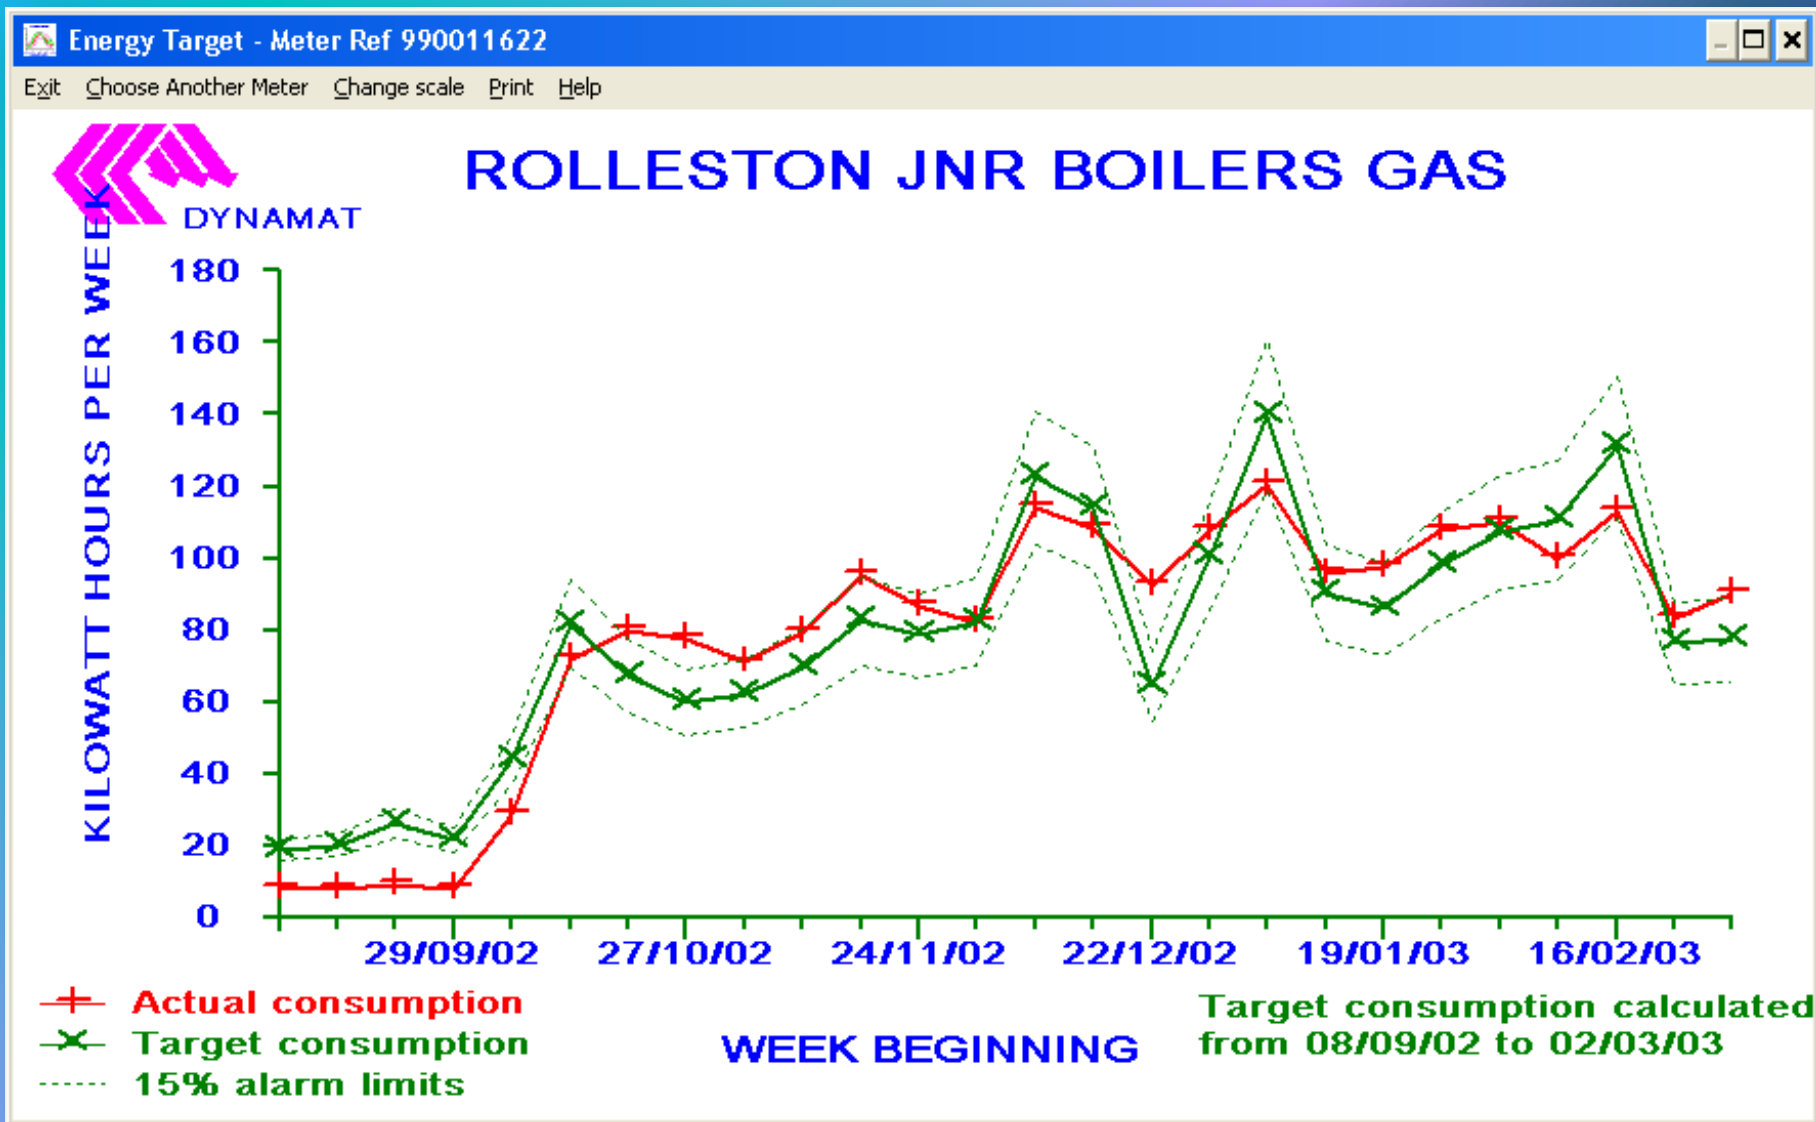


# Rolleston Infant / Junior & Teachers Centre - Water

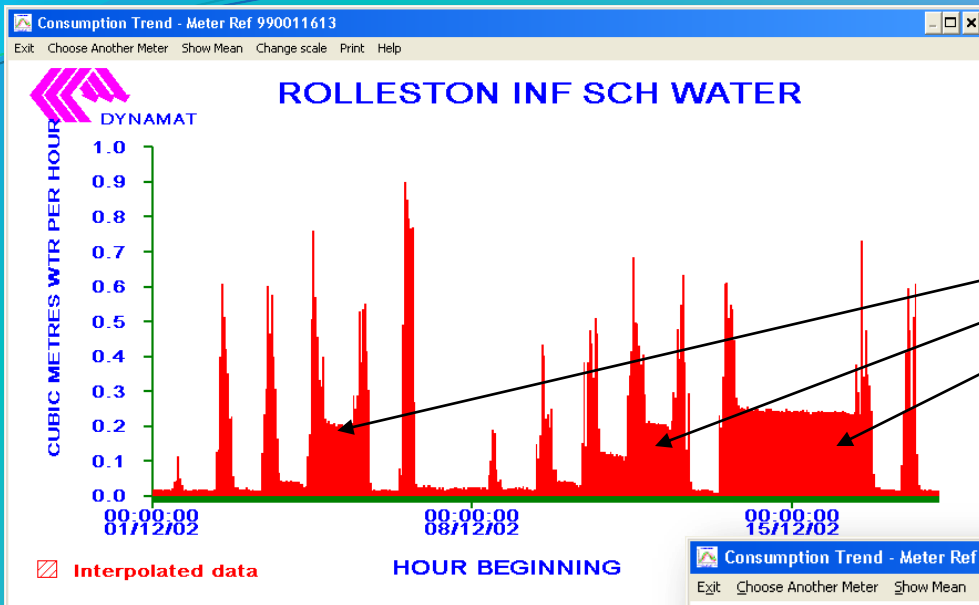


Wastage

Base Load

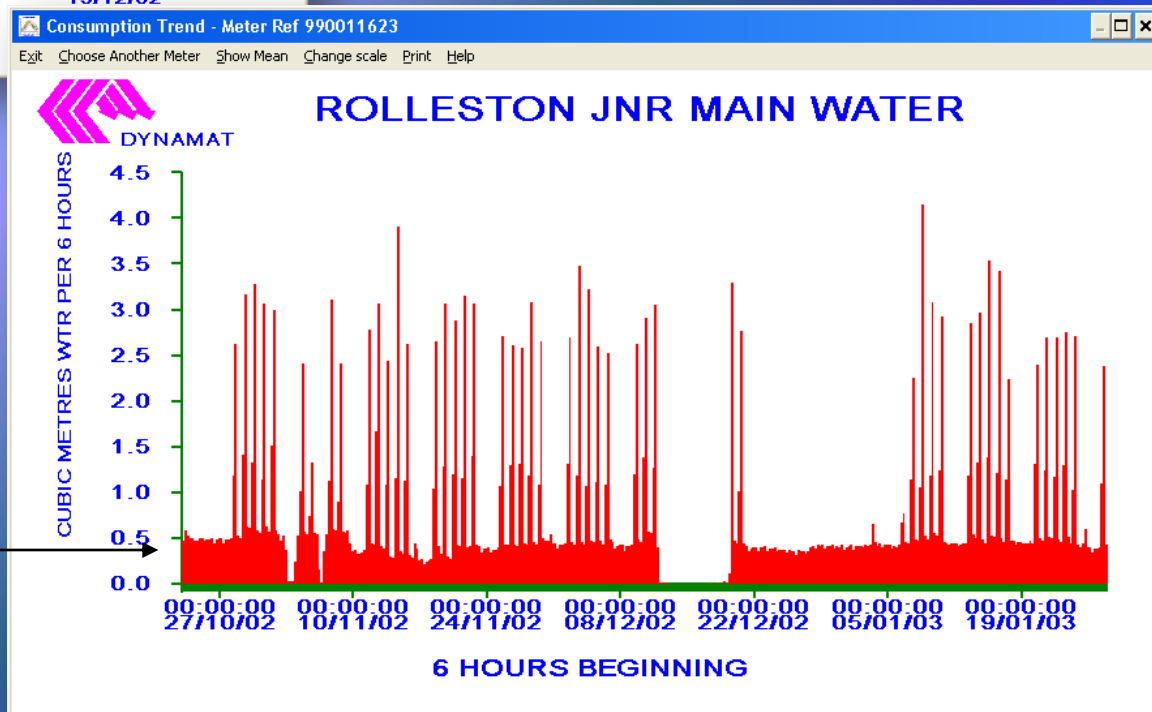

# Rolleston Junior School - Electricity

## Electricity Usage Profile

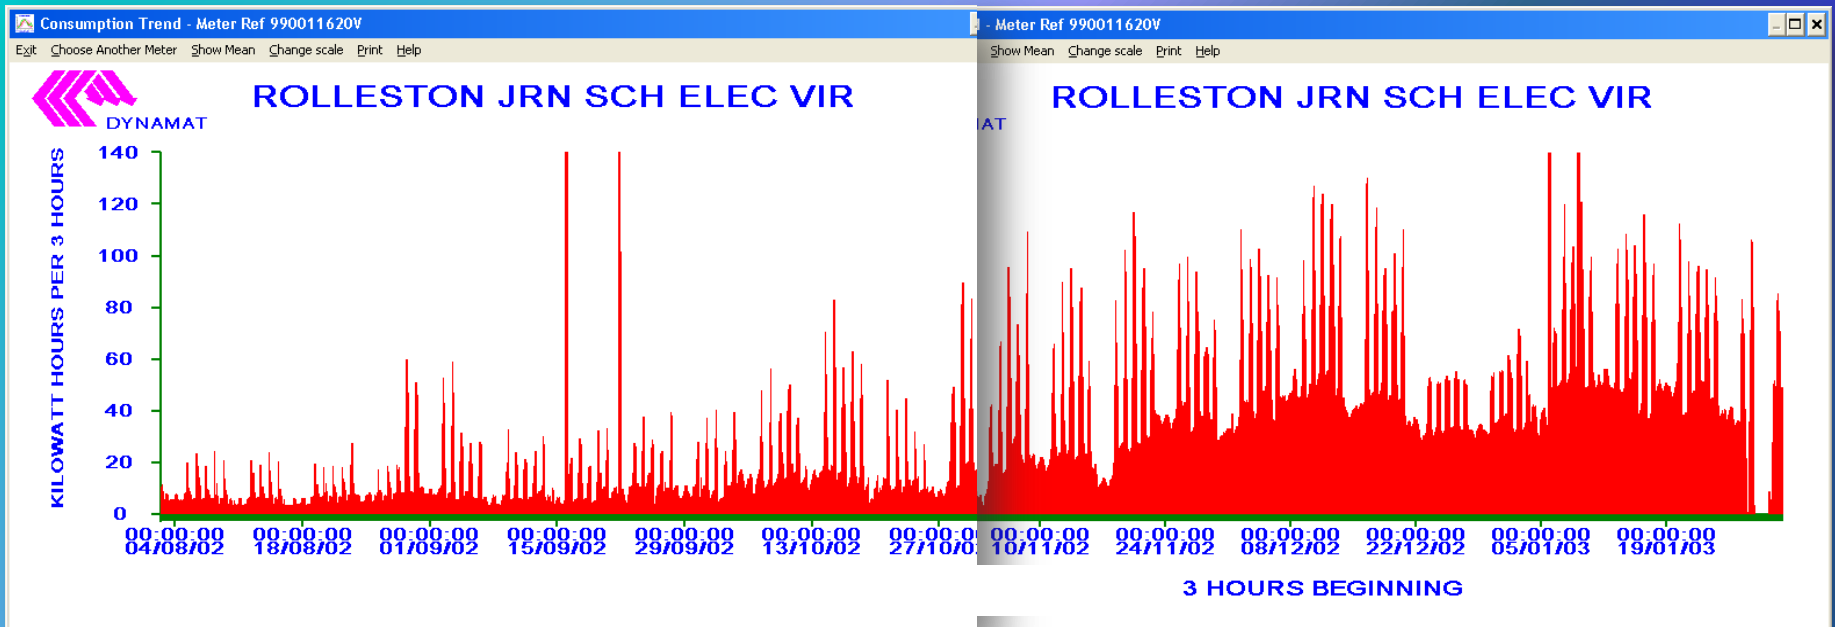

# Rolleston Infant / Junior & Teachers Centre-Electricity

End of October the Base Load had more then doubled, however it appears that end of yesterday was the first time this has gone down to normal levels.

